



Short-term forecasting of power quality distortions in electrical energy systems with long short-term memory and gated recurrent unit networks

İsmail Bozdağ^a, Serhat Berat Efe^{b,*}, İlyas Özer^c

a. Department of Technical Administration, Bandırma Organized Industrial Zone, Bandırma, Turkey.

b. Department of Electrical Engineering, Bandırma Onyedi Eylül University, Bandırma, Turkey.

c. Department of Computer Engineering, Bandırma Onyedi Eylül University, Bandırma, Turkey.

* Corresponding author: sefe@bandirma.edu.tr (S.B. Efe)

Received 10 November 2022; Received in revised form 24 May 2023; Accepted 22 August 2023

Keywords

Power quality;
Power system protection;
Harmonic forecasting;
Long-Short Term Memory (LSTM);
Power system analysis.

Abstract

Technological development has led to a diversification of loads in transmission and distribution systems. The rise of non-linear loads in the system is one of the biggest effects of this variation as semiconductor technology develops. Nonlinear loads are characterized by current and voltage characteristics that are not purely sinusoidal, also known as harmonics. Harmonics cause the system insulation to degrade and increase energy loss. Therefore, it's crucial to get rid of harmonics before they occur. This study intends to lower the risk of distribution system damage by employing complex harmonic forecasting methods. A Recurrent Neural Network (RNN)-based forecasting algorithm has been created by using actual system power quality data obtained from the organized industrial zone in Bandırma, Turkey. Parameters that are most likely to be neglected in simulation studies are also taken into account in the calculation by using actual data. Active power data, current harmonic data, and calendar data were used together to design a harmonic forecasting model. Graphs and calculations were used to discuss the results. The obtained minimum values of the Root Mean Square Error (RMSE), Mean Absolute Error (MAE), and Mean Absolute Percentage Error (MAPE) are 2,116, 0,666, and 11,619, respectively. The convergence as a result of these calculations has allowed high forecasting performance of power quality distortions.

1. Introduction

The transmission and distribution network operators' top priorities include providing continuous and uninterrupted energy as well as high-quality energy while avoiding any negative consequences from the facilities. In a precise alternating current power system, electrical energy is produced, transmitted, and distributed at specific voltage levels with a single constant frequency. Waveforms for voltage and current in these systems are fully sinusoidal. These requirements, however, cannot be entirely accomplished in practice. The term "harmonic" refers to fluctuations in alternating current and voltage brought on by abruptly switching loads or generators with non-sinusoidal voltage waveforms [1,2]. In order to reduce harmonics and ensure compliance with power quality standards, harmonic analysis is required in power systems. They should be detected and eliminated as soon as possible

to keep the system robust.

A considerable amount of literature has been published on analysis, classification, and elimination of power system harmonics [3-6]. Fast Fourier Transform (FFT) is the most well-known method for harmonic analysis, where the harmonics can be minimized or eliminated by using active-passive harmonic filters and other optimization-based methods, which have been widely studied for years [7-9]. These devices are designed to eliminate harmonics to avoid their disruptive effects.

Harmonics have traditionally been studied using signal processing methods that are comprehensively reviewed in [10]. FFT has been widely used for analysis of harmonics due to its computational efficiency. In addition, other techniques including Discrete Wavelet Transform (DWT) [11] and S-transform [12] have been used to analyze power

To cite this article:

İ. Bozdağ, S.B. Efe, and İ. Özer "Short-term forecasting of power quality distortions in electrical energy systems with long short-term memory and gated recurrent unit networks", *Scientia Iranica* (2025) 32(15): 7300. <https://doi.org/10.24200/sci.2023.61430.7300>

system harmonics. On the other hand, in recent years, machine learning-based approaches, which allow researchers to process much more data and obtain more precise results, have become more popular with the rapid development of computing technologies [13]. Machine learning methods, including Artificial Neural Network (ANN) [14], support vector machines [15], and decision trees [16], have also been widely used. Even if outstanding results have been obtained in practical applications, accuracy and analysis speed still need to be increased to meet the demands of real-time applications [17].

Harmonic studies have evolved to prediction and estimation issues in recent years, as [18-20] focus on the monitoring and prediction of harmonics. To mitigate the undesirable effects of harmonics and their variations, such as sub-harmonics and inter-harmonics, a proper prediction or estimation should be performed. Modern estimation/prediction techniques employ adaptive signal processing approaches [21].

Although prediction and estimation studies include short-term estimations, new planning strategies have begun to be researched in recent years. Harmonic forecasting is one of the most significant current discussions in power system harmonic studies.

Power system operators are able to proactively manage and mitigate harmonic-related issues, assess power quality, ensure compliance with standards and regulations, protect equipment, optimize system operation, make it easier to integrate renewable energy sources, and plan smart grids by using harmonic forecasting studies [22-24].

Harmonic forecasting helps in predicting the future behavior of harmonics, enabling power system operators to assess power quality and identify potential harmonic-related problems in advance. These studies can aid in grid planning and operation by providing insights into the potential impact of harmonics on the performance of the power grid. This allows for proactive mitigation measures to be taken to minimize the impact of harmonics on the grid, optimize system operation, and avoid costly corrective actions. It can also help identify potential harmonic-related issues that could damage or degrade the performance of equipment, enabling timely measures to be taken to protect the equipment from harm and reduce maintenance costs.

Power systems are subject to various standards and regulations related to power quality, including limits on harmonic distortion levels. Harmonic forecasting can assist in monitoring and predicting harmonic distortion levels in power grids, helping to ensure compliance with relevant standards and regulations.

Harmonic forecasting can be useful in the context of smart grid applications, where real-time monitoring and control of power quality parameters are critical. Harmonic forecasting can provide inputs for advanced analytics, decision-making algorithms, and control strategies in smart grids, facilitating efficient and reliable operation of the grid [25].

This paper proposes a harmonic forecasting approach utilizing Long Short-Term Memory (LSTM) and Gated Recurrent Unit (GRU) architectures by using real data obtained from an industrial feeder. The main motivation of the study is to rapidly and accurately forecast the harmonics before occurrence in accordance with the standards [26].

The main contribution of this article can be summarized as follows:

- While harmonic estimation and prediction studies are well-established and widely researched, harmonic forecasting studies are relatively less common and less mature in the field of power system engineering. Harmonic forecasting techniques are still an active area of research, and there is ongoing development of new methods and approaches for accurate and reliable harmonic forecasting in power grids;
- In the literature, studies show a strong correlation between calendar data and loading values [27-29]. Therefore, in this study, current harmonic prediction was made by using calendar data, active power data, and harmonic data together to observe if a similar correlation exists on the harmonic side;
- In this study, real-world one-year data with 10-minute resolution were used for analysis. This allows all parameters, including unforeseen peak values, to be taken into account, which may have been neglected in simulation studies, and achieve more accurate results;
- Two main forecasting models, LSTM and GRU that widely used in power system studies, were compared to obtain the best results.

2. Definition of power system harmonics

Sinusoidal waveform distortions occur in energy distribution systems when a sinusoidal voltage source is applied to a non-linear load. The current waveform, which should take the form of a sine wave, is distorted by waveforms that differ from the main grid frequency. These additional sinusoidal currents that are distinct from the grid frequency and sourced from the non-linear loads are referred to as harmonic currents. Certain mathematical models are used to determine harmonics and inter-harmonics, which are summarized in Table 1.

The amount of Total Harmonic Distortion (THD) is determined by dividing the effective Root Mean Square (RMS) values of the voltage harmonic components by the effective value of the main component. THD for voltage and current can be defined as given in Eqs. (1) and (2), respectively:

$$THD_V = \frac{1}{U_1} \left(\sum_{n=2}^{\infty} U_n^2 \right)^{1/2}, \quad (1)$$

$$THD_I = \frac{1}{I_1} \left(\sum_{n=2}^{\infty} I_n^2 \right)^{1/2}. \quad (2)$$

The Fourier series can be used to express the instantaneous voltage and current values that have harmonic components in the power system as given in Eqs. (3) and (4), respectively.

$$v(t) = \sum_{n=1}^{\infty} v_n(t) = \sum_{n=1}^{\infty} \sqrt{2} V_n \sin(n\omega_1 t + \theta_n), \quad (3)$$

$$i(t) = \sum_{n=1}^{\infty} i_n(t) = \sum_{n=1}^{\infty} \sqrt{2} I_n \sin(n\omega_1 t + \theta_n). \quad (4)$$

The Direct Current (DC) terms have been deleted to simplify calculation. The instantaneous values of the n th harmonic current and voltage are i_n and v_n . The effective harmonic

Table 1. Mathematical definitions of harmonics.

DC component	$f_\omega = nf_1; n = 0$	
Harmonic	$f_\omega = nf_1$	$n > 0$
Inter-harmonic	$f_\omega \neq nf_1$	f_ω : Spectral component frequency
Sub-harmonic	$f_\omega > 0 \text{ Hz and } f_\omega < f_1$	f_1 : Fundamental frequency

values for voltage and current are V_n and I_n , ω_1 is the fundamental frequency's angular frequency. θ_n and φ_n are the phase angles of the n th harmonic voltage and current.

3. Harmonic forecasting methodology

This study is concerned with developing an accurate and reliable model for harmonic forecasting in power systems. ANN is a prominent method used for harmonic forecasting. In this context, two Recurrent Neural Network (RNN) based forecasting models with different architectures are proposed in this paper.

RNNs are unsupervised learning techniques that perform remarkably well when used to classify time series data. Compared to other prediction models, RNNs perform significantly better [30]. RNNs use both the samples they are exposed to currently, as shown in Figure 1, and those they perceive over time, in contrast to standard feed-forward neural networks.

The RNNs thus perform better while learning from the events they come across throughout time. RNNs benefit from this capability when anticipating electricity load [29]. The input sequence is supplied as in Eq. (5), where the value of k can change depending on the length of the sequence in the various samples.

$$[x_1, x_2, x_3, \dots, x_n]; \quad x_i \in \mathbb{R}^d. \quad (5)$$

A hidden state is formed in the array given in Eq. (6) at each iteration of the RNN model.

$$[h_1, h_2, h_3, \dots, h_n]. \quad (6)$$

The hidden state's activation at time t , depending on the previous hidden state and the current input, can be expressed as given in Eq. (7).



$$h_t = f(x_t, h_{t-1}). \quad (7)$$

The LSTM is a unique kind of deep learning neural network that has been reported to be state-of-the-art in several time series challenges, including power system analysis issues. As an intelligent approach, LSTM structures are used in various research, including speech recognition, translation, language modeling, short-term electricity demand estimation, and the forecasting of power quality distortions, which is one of the primary issues in power systems [31-33]. The internal structure of each module is made up of 4 distinct portions that interact with one another, unlike typical RNNs. There are three distinct gates with labels for forget, input, and output inside the LSTM module, as shown in the block diagram of given in Figure 2.

Mathematical expressions of forget, input, and output gates can be defined as given in Eqs. (8)-(10).

$$f_t = \sigma(W_f \cdot [h_{t-1}, x_t] + b_f), \quad (8)$$

$$i_t = \sigma(W_i \cdot [h_{t-1}, x_t] + b_i), \quad (9)$$

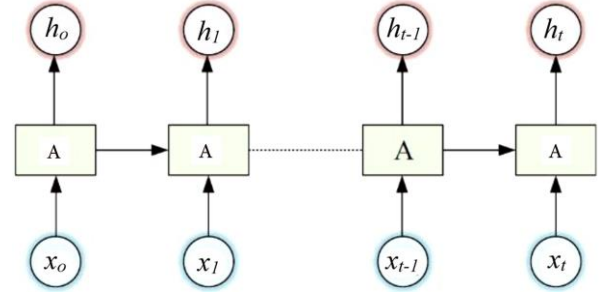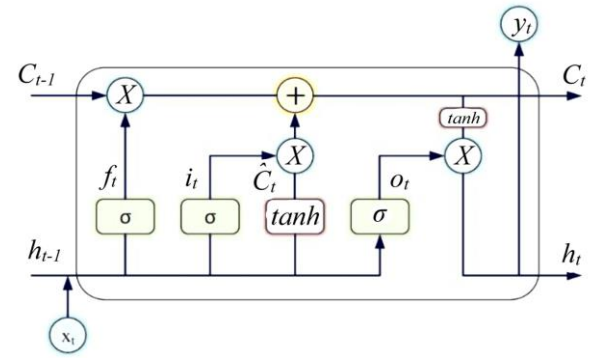**Figure 1.** RNN Architecture.**Figure 2.** Block diagram of LSTM

$$C = \tanh(W_c \cdot [h_{t-1}, x_t] + b_c). \quad (10)$$

After the determination of candidate values, the new state information calculation process and the output of the system can be mathematically expressed as given in Eqs. (11)-(13):

$$C_t = f_t \otimes C_{t-1} + i_t \otimes C_t, \quad (11)$$

$$o_t = \sigma(W_o \cdot [h_{t-1}, x_t] + b_o), \quad (12)$$

$$h_t = o_t \otimes \tanh(C_t). \quad (13)$$

On the other hand, one of the most widely used alternative techniques for power system forecasting studies, called GRU, which was introduced by Cho et al. [34], is given in Figure 3.

The GRU is similar to an LSTM with a forget gate, but because it lacks an output gate, it has fewer parameters than an LSTM.

According to the block diagram, the mathematical expressions of the fully gated GRU are given in Eqs. (14)-(17):

$$z_t = \sigma(W_z x_t + U_z h_{t-1} + b_z), \quad (14)$$

$$r_t = \sigma(W_r x_t + U_r h_{t-1} + b_r), \quad (15)$$

$$\hat{h}_t = \phi_h(W_h x_t + U_h (r_t \otimes h_{t-1}) + b_h), \quad (16)$$

$$h_t = z_t \otimes \hat{h}_t + (1 - z_t) \otimes h_{t-1}. \quad (17)$$

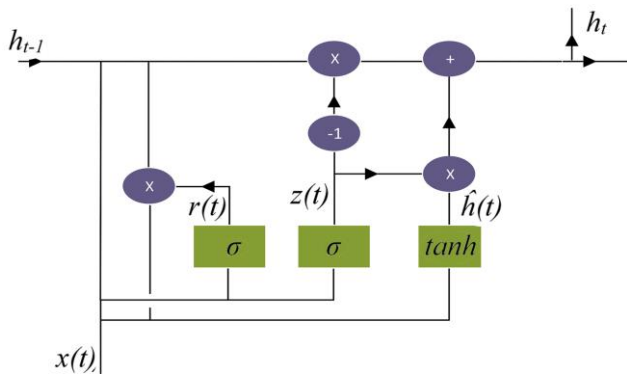


Figure 3. Fully gated version of GRU.

LSTM and GRU are types of RNN architectures that are particularly useful for harmonic forecasting. Harmonic forecasting involves predicting patterns that repeat over fixed intervals, such as daily, weekly, or yearly cycles.

LSTM and GRU models are helpful for harmonic forecasting because they have abilities capturing periodic patterns in harmonic data, adapt to the length of the input sequence, making them flexible for different forecasting scenarios, effectiveness at capturing the intricate relationships and cyclic patterns present in harmonic data, help smooth out noisy inputs, make more accurate predictions and generate forecasts for a desired number of time steps ahead.

Overall, the ability of LSTM and GRU models to capture long-term dependencies, handle variable-length sequences, learn complex temporal patterns, handle noisy data, and support multi-step forecasting makes them well-suited for harmonic forecasting tasks. These models have been widely used in various time series prediction applications, including energy load forecasting, stock market prediction, and weather forecasting, where harmonic patterns are prevalent.

Because they are specifically created to prevent long-term dependency issues, the LSTM and GRU models are widely used in time series forecasting. These models are effective machine learning techniques that can reduce the negative consequences of long-term dependency issues in harmonic forecasting.

In a comparison of LSTM and GRU networks for learning harmonic features, GRUs outperform LSTM networks on low-complexity sequences, while LSTMs outperform GRUs on high-complexity sequences [35-37]. When Autoregressive Integrated Moving Average (ARIMA), LSTM, and GRU models were put side by side to predict time series, another study discovered that the GRU outperformed the LSTM in terms of harmonic forecasting [38]. The major issue is whether to apply GRU or utilize LSTM. The LSTM is more specialized and the GRU cell is more responsive to data due to its architecture. This may help to understand why GRUs occasionally perform better than LSTMs and vice versa [39]. Therefore, the purpose of this study is to compare GRU and LSTM models for forecasting the occurrence of current harmonics in a real power system and to examine sensitivity rates as well as accuracy rates.

4. System setup

This study focused on forecasting the current harmonics that occur in electrical energy systems. In this context, a Janitza UMG 512 energy analyzer that measures up to 63



Figure 4. Installation of data collecting unit.

odd and even harmonics, inter-harmonics, positive, negative, and zero components, imbalance, flicker, voltage peak factor, voltage, current, active power, reactive power, and frequency half-wave effective values concurrently, which was located in the Bandırma Organized Industrial Zone distribution center used to obtain the data. The installation is shown in Figure 4. It also has crucial features like active energy measurement accuracy class 0.2, A-class certified measurement accuracy, continuous sampling of voltage and current measurement inputs at 25,600 Hz, 512 sampling points per period, and recording of more than 2000 measurement values per cycle. The pertinent analyzer logs the electrical characteristics of the local facilities as iron-steel, food, textile, etc.

Data were collected; thus, analysis was performed separately for L1, L2 and L3. The current waveform for L1 was given in Figure 5 for a better understanding of distortions, where the experimental setup block diagram was shown in Figure 6.

The relevant dataset was created from recorded data between January 6, 2020, and January 1, 2021. Harmonic value, active power value, year, month, day, weekdays and day of the week data for each line were prepared in the dataset in the appropriate Comma-Separated Values (CSV) format. 90% of the dataset is reserved for training, where 10% is used for testing. There are 45716 total data points during a period of 10 minutes. Active power and current harmonic data for each line were obtained in excel format from the analyzer.

Evaluation metrics are approaches that are used to measure the quality of the intelligent models. As there are many different types of evaluation metrics available to test a model, in this paper, Mean Absolute Percentage Error (MAPE), Root Mean Square Error (RMSE) and Mean Absolute Error (MAE) metrics were used to evaluate forecasting performance. MAPE, RMSE and MAE values are widely used as error comparison metrics in forecast studies of time series data. The quality of forecasted values has been assessed by statistical measures including MAPE, RMSE and MAE [29]. The forecasting results were evaluated using the MAPE, RMSE and MAE as given in Eq. (18), Eq. (19), and Eq. (20), respectively.

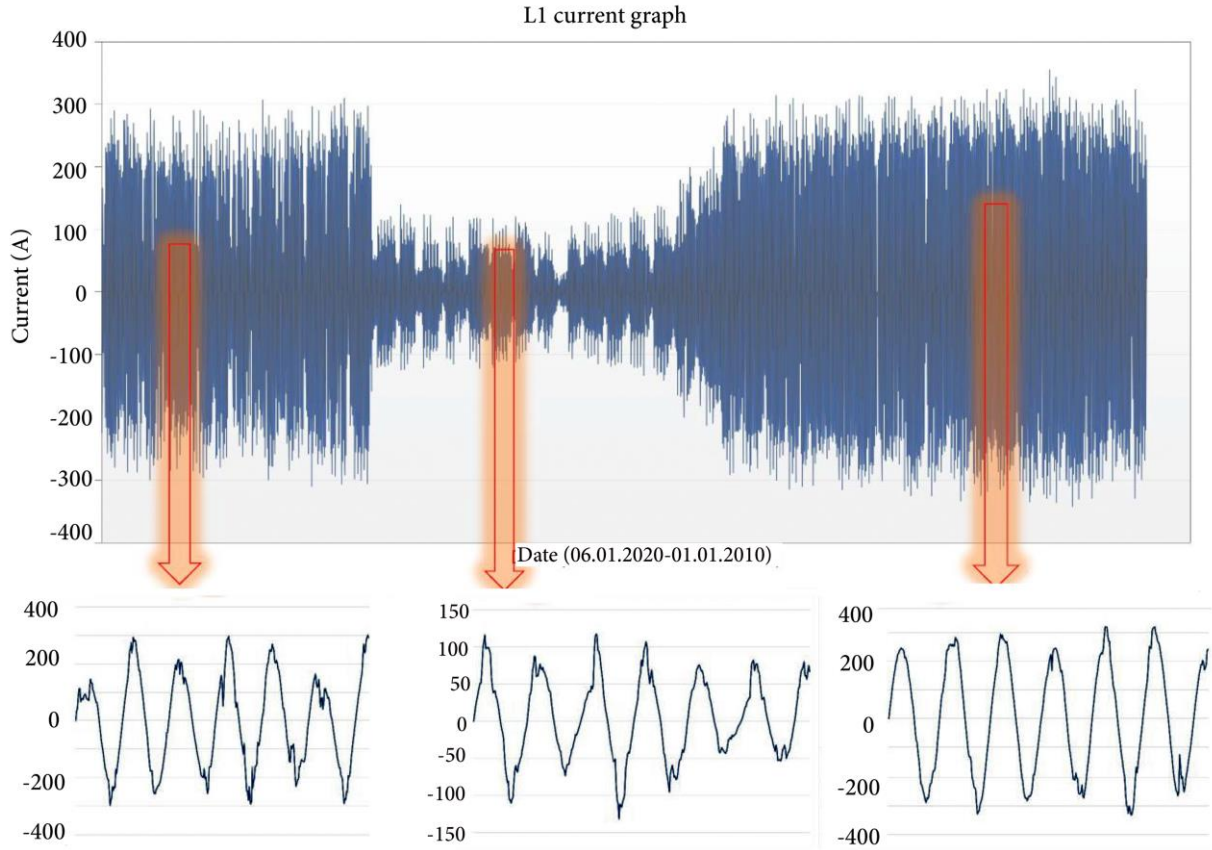


Figure 5. L1 current waveform.

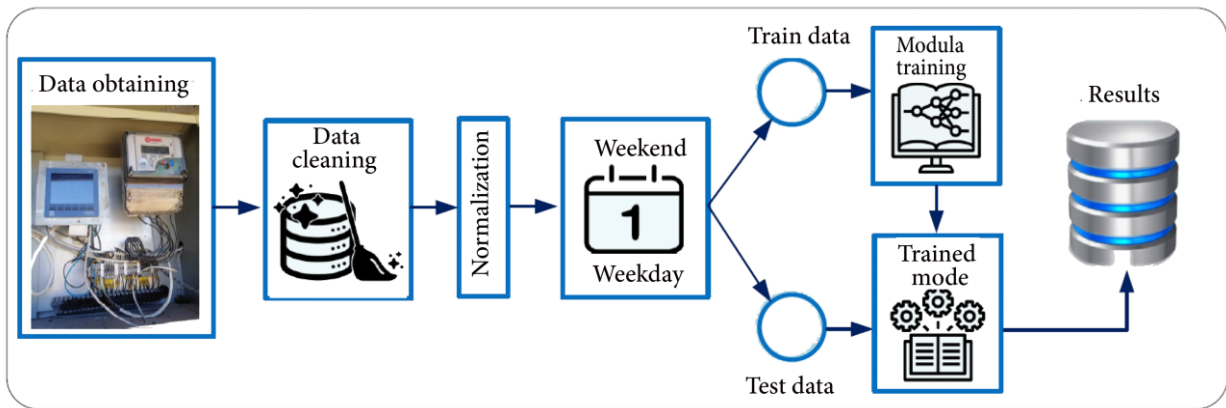


Figure 6. Experimental setup.

$$\text{MAPE} = \frac{100}{n} \sum_{t=1}^n \frac{|e_t|}{|A_t|}, \quad (18)$$

$$\text{RMSE} = \sqrt{\frac{1}{n} \sum_{t=1}^n e_t^2}, \quad (19)$$

$$\text{MAE} = \frac{1}{n} \sum_{t=1}^n |e_t|. \quad (20)$$

In these equations, n denotes the sample size, e_t is the difference between the actual value and the forecasted value and A_t is the total number of forecasting points.

5. Experimental evaluation and THD₁ forecasting

The main goal of this study is to prevent harmonic-based failures that may occur in the future. Therefore, the short-term harmonic forecasting approach has been applied, and

the time step was set to 1, as the target point of forecasting is 10 minutes ahead. ANN models, to which the collected and normalized data were applied, consist of three layers. These sections can be defined as the input layer, LSTM or GRU algorithms, and output layer. The data contain harmonic value, active power value, year, month, day, weekdays, and day of the week. In this study, active power data, current harmonic data and calendar data were used together for harmonic forecasting.

The model was initially trained using random weights. The forecasting results were recorded after the training neural network-based methods are so intuitive that different initial values can provide various outcomes.

Layer statement represents the hidden layers in ANNs. The model architecture used for forecasting consists of three layers: Input, LSTM or GRU, and output. Harmonic data are applied to the input layer with 10-minute resolution.

Table 2. Test results for L1, L2, and L3.

Line	Layer	Nodes	LSTM			GRU			
			Metric errors			Metric errors			
			RMSE	MAE	MAPE	RMSE	MAE	MAPE	
L1	1	25	2,286	0,734	11,735	2,253	0,698	10,820	
		50	2,411	0,760	13,615	2,571	0,963	15,762	
		100	2,459	0,804	14,486	2,487	0,780	12,288	
		200	2,413	0,739	13,178	2,902	1,599	30,065	
	*2	25	2,534	0,654	10,424	2,334	0,916	17,065	
		50	2,582	1,455	24,281	2,246	0,962	17,698	
		*100	*2,193	*0,694	*12,111	2,501	0,844	13,202	
		200	2,310	0,787	13,953	2,784	1,432	27,572	
	L2	1	25	2,382	0,680	10,074	2,768	1,460	27,921
			50	2,432	0,765	13,548	2,695	1,104	20,709
100			2,363	0,792	14,268	2,640	0,610	9,976	
200			2,610	1,292	24,501	2,778	1,526	29,213	
*2		25	2,700	1,261	23,484	2,489	0,715	11,264	
		*50	*2,354	*0,759	*12,329	2,762	1,372	26,210	
		100	2,952	1,717	32,897	2,460	0,944	17,218	
		200	2,497	0,838	14,350	2,973	1,553	29,614	
L3		1	25	2,277	0,672	12,915	2,527	0,863	15,234
			50	2,548	1,089	23,665	2,872	1,157	24,834
	100		2,648	1,068	22,884	2,520	1,045	22,603	
	200		2,515	0,793	16,219	2,508	1,074	23,321	
	*2	*25	*2,116	*0,666	*11,619	2,173	0,776	13,486	
		50	2,326	1,153	25,337	2,503	1,417	27,640	
		100	2,447	1,104	21,394	2,159	0,782	15,860	
		200	2,639	1,300	27,998	3,064	1,311	28,071	

Various models were tried to obtain the best results. Therefore, the proposed model includes LSTM and GRU layers consisting of [25-200] nodes with one or two hidden layers after the input. Finally, the forecasted results are obtained from the output layer that is formed by one fully-connected neuron.

The study was carried out on a computer with 2 Intel Xeon Gold 6354 processors with a base frequency of 3 GHz and a maximum turbo frequency of 3.6 GHz. The total number of cores of the processors is 36 and the total number of threads is 72. The device is equipped with a total of 128 GB of RAM. It also has a 2TB M2 Solid-State Disk (SSD). In addition to these, there is an Nvidia RTX 3090 graphics card on the computer. Ubuntu 22.04 version is used as the operating system. Python 3.7 version was used together with the Anaconda distribution as the programming language in the study. TensorFlow version 2.10.0 was preferred for training machine learning models.

The "epoch" value, which indicates the number of iterations of the training, was applied as a constant 200. These values have been tested separately as single and double-layer in LSTM and GRU networks and all test structures with results were summarized in Table 2.

RMSE, MAE, and MAPE scatter plots of L1, L2 and L3 for both LSTM and GRU were given in Figure 7, Figure 8, and Figure 12, respectively.

Actual and forecasted Total Harmonic Distortion for Current (THD_i) graphs obtained in accordance with RMSE, MAE and MAPE values of L1, L2 and L3 are shown in Figure 10, Figures 11, and 12, respectively.

The peak values appearing in the current harmonics graph of each line originate from the arc furnace that is fed by the distribution transformer unit. These changes,

which occur depending on the working process of the facility during certain periods of production, can be considered an important indicator in terms of observing the performance of the model proposed within the scope of this study. When the relevant points in the graphics are examined, it can be seen that the proposed model shows a good forecasting performance at these extreme change points.

It was mentioned in the previous sections that harmonic forecasting studies are a relatively new topic. As a result, it was difficult to find much research in the literature to compare. In Ref. [40], average RMSE indices obtained from

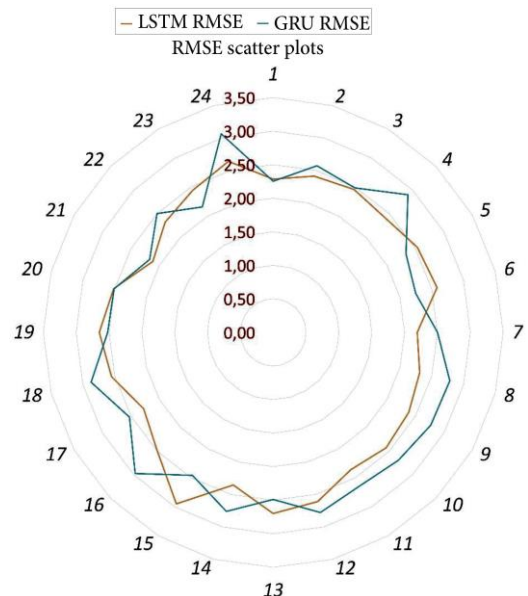


Figure 7. RMSE scatter plots.

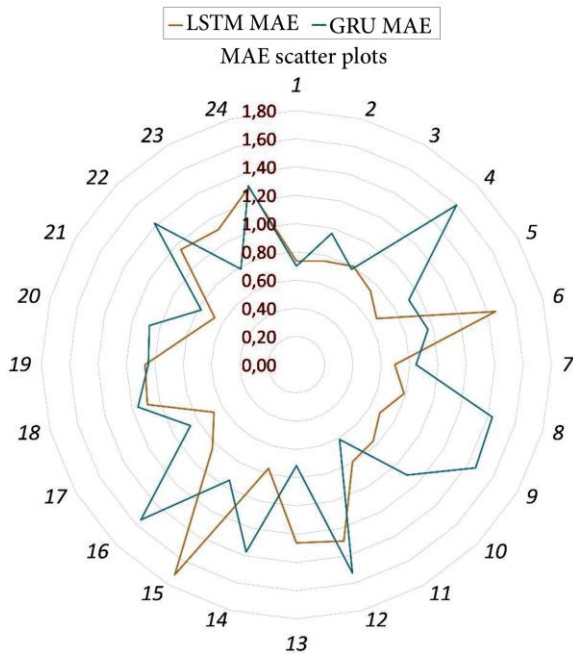


Figure 8. MAE scatter plots.

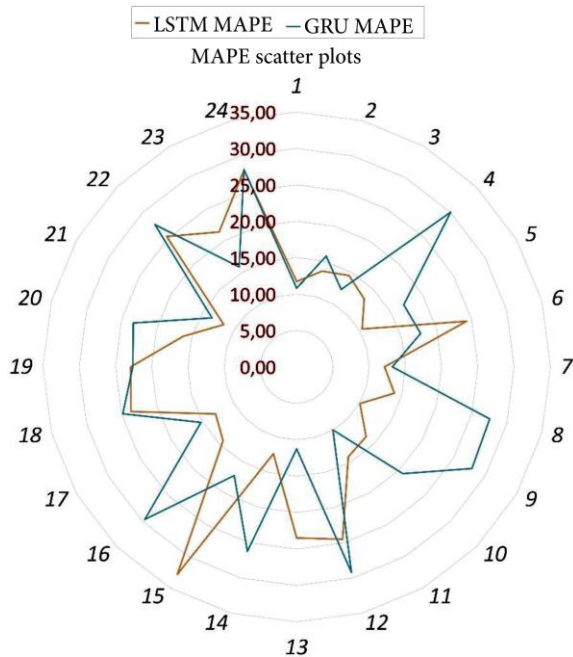


Figure 9. MAPE scatter plots.

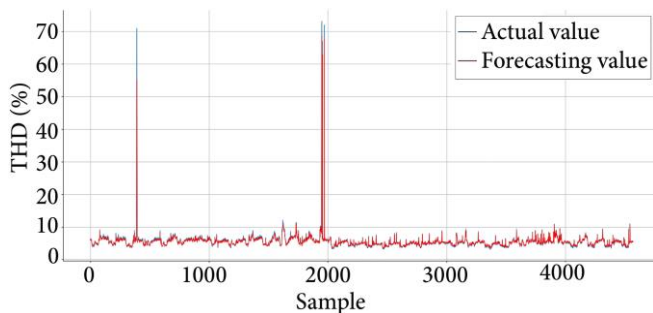


Figure 10. Actual and forecast values for L1.

similar studies are given as 5,84; 6,91; 10,06 and 22,53, where the best RMSE value for the proposed methodology is 2,116. Considering these results, it is concluded that the error rate in the results obtained in the article is lower than

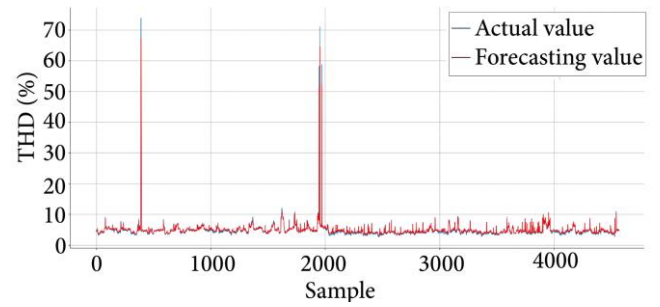


Figure 11. Actual and forecasting values for L2.

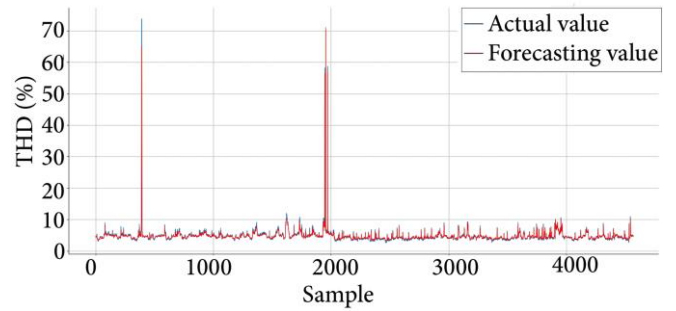


Figure 12. Actual and forecast values for L3.

similar studies in the literature, and in this case, the results can be considered acceptable.

6. Conclusion

The financial losses associated with low Power Quality (PQ) and harmonics are considerable in both small and large power systems. This situation reveals the importance of detecting harmonics. Prior knowledge of the harmonics can enable system-specific actions to be planned from the outset. Although estimation and prediction studies are frequently encountered in the literature within the scope of power systems analysis, harmonic forecasting has been studied less frequently. Harmonic forecasting plays a key role in preventing breakdowns and delivering high-quality electricity. Additionally, forecasting enables the use of harmonic filters as necessary, which helps to increase equipment longevity. In this context, this study focused on forecasting the Total Harmonic Distortion for Current (THD_i) using the Long Short-Term Memory (LSTM) and Gated Recurrent Unit (GRU) models.

Studies in the literature show that relatively high performance can be achieved with LSTM and GRU in the forecasting of power quality problems. Therefore, this study was based on these two models. The studied dataset consists of a total of 45716 data points collected between January 6, 2020, and January 1, 2021, in 10-minute intervals, and 4572, which was 10% of the total, were used for testing. This dataset was used to conduct tests on the forecasting of THD_i using 8 different models, including LSTM and GRU networks for each line separately, and the results were compared to select the best forecasting approach. The models were revised in accordance with various scenarios in order to attain the best performance. Following the analyses, the best forecasting values were obtained for L1, L2, and L3 with 2 layers and 100 nodes, 2 respectively.

The fact that power systems have various characteristics in actual operating conditions has led to obtaining the best

results with models that consist of different node and layer structures for each line. This situation can be defined as proof that the proposed model yields result through learning, without memorization.

The dataset contains the data obtained directly from the analyzer, and a cleaning process has been applied only by removing points with zero values that occur due to problems in data transfer. In order to see the performance of the proposed model in different operating conditions, the distortions reaching very high levels because of various reasons (fault, sudden loading, etc.) were not removed from the dataset during the cleaning process. As a result, it is clear that the model has a high forecasting performance not only in stable operation but also in extreme conditions.

Nomenclature

θ_n, φ_n : Phase angle;

x_t : Input vector;

h_t : Output vector;

$\hat{h}_t$: Activation vector;

z_t : Update-gate vector;

r_t : Reset-gate vector;

w, U : Parameter matrices;

b : Vector

Funding

This research did not receive any specific grant from funding agencies in the public, commercial, or not-for-profit sectors.

Conflicts of interest

The authors declare that they have no known competing financial interests or personal relationships that could have appeared to influence the work reported in this paper.

Authors contribution statement

First author: Data Collection and data normalization, Writing-review & editing

Second author: Conceptualization; Formal analysis; Supervision; Administration; Resources; Writing-original draft; Writing-review & editing

Third author: Data curation; Investigation; Methodology; Software; Validation; Visualization; Writing-review & editing

References

1. Efe, S.B., Ozbay, H., and Ozer, I. "Experimental design and analysis of adaptive LED illumination system", *Light and Engineering*, **30**(4), pp. 63-70 (2022).
<https://doi.org/10.33383/2021-107>
2. Özer, İ., Efe, S.B., and Özbay, H. "CNN/Bi-LSTM-based deep learning algorithm for classification of power quality disturbances by using spectrogram images", *International Transactions on Electrical Energy Systems*, **31**(12), pp. 1-16 (2021).
<https://doi.org/10.1002/2050-7038.13204>
3. Clement Veliz, F., Varricchio, S.L., and de Oliveira Costa, C. "Determination of harmonic contributions using active filter: Theoretical and experimental results", *International Journal of Electrical Power and Energy Systems*, **137**, 107664 (2022).
<https://doi.org/10.1016/j.ijepes.2021.107664>
4. Melo, I.D., Pereira, J.L.R., Variz, A.M., et al. "Allocation and sizing of single tuned passive filters in three-phase distribution systems for power quality improvement", *Electric Power Systems Research*, **180**, 106128 (2020).
<https://doi.org/10.1016/j.epsr.2019.106128>
5. PomalisC.S., M., Chouhy Leborgne, R., Herrera-Orozco, A.R., et al. "NSGAI optimization for single phase passive filter allocation in distribution systems", *Electric Power Systems Research*, **176**, 105923 (2019).
<https://doi.org/10.1016/j.epsr.2019.105923>
6. Beck, Y. and Machlev, R. "Harmonic loads classification by means of currents' physical components", *Energies (Basel)*, **12**(21), 4137 (2019).
<https://doi.org/10.3390/en12214137>
7. Rüstemli, S. and Cengiz, M.S. "Active filter solutions in energy systems", *Turkish Journal of Electrical Engineering and Computer Sciences*, **23**(6), pp. 1587-1607 (2015).
<https://doi.org/10.3906/elk-1402-212>
8. Tan, A., Bayındır, K.Ç., Cuma, M.U., et al. "Multiple harmonic elimination-based feedback controller for shunt hybrid active power filter", *IET Power Electronics*, **10**(8), pp. 945-956 (2017).
<https://doi.org/10.1049/iet-pel.2016.0674>
9. Perin, D., Karaoglan, A., and Yilmaz, K. "Using grey wolf optimizer to minimize voltage total harmonic distortion of a salient-pole synchronous generator", *Scientia Iranica*, **30**(2), pp. 592-604 (2023).
<https://doi.org/10.24200/sci.2021.57657.5349>
10. Mishra, M. "Power quality disturbance detection and classification using signal processing and soft computing techniques: A comprehensive review", *International Transactions on Electrical Energy Systems*, **29**(8), pp. 1-42 (2019).
<https://doi.org/10.1002/2050-7038.12008>
11. Khokhar, S., Mohd Zin, A.A., Memon, A.P., et al. "A new optimal feature selection algorithm for classification of power quality disturbances using discrete wavelet transform and probabilistic neural network", *Measurement (Lond)*, **95**, pp. 246-259 (2017).
<https://doi.org/10.1016/j.measurement.2016.10.013>
12. Wang, H., Wang, P., and Liu, T. "Power quality disturbance classification using the S-transform and probabilistic neural network", *Energies (Basel)*, **10**(1), pp. 1-19 (2017).
<https://doi.org/10.3390/en10010107>

13. Eslami, A., Negnevitsky, M., Franklin, E., et al. "Review of AI applications in harmonic analysis in power systems", *Renewable and Sustainable Energy Reviews*, **154**, 111897 (2022).
<https://doi.org/10.1016/j.rser.2021.111897>
14. Beltran-Carbajal, F. and Tapia-Olvera, R. "An adaptive neural online estimation approach of harmonic components", *Electric Power Systems Research*, **186**, 106406 (2020).
<https://doi.org/10.1016/j.epsr.2020.106406>
15. Saxena, A., Alshamrani, A.M., Alrasheedi, A.F., et al. "A hybrid approach based on principal component analysis for power quality event classification using support vector machines", *Mathematics*, **10**(15), 2780 (2022). <https://doi.org/10.3390/math10152780>
16. Zhao, W., Shang, L., and Sun, J. "Power quality disturbance classification based on time-frequency domain multi-feature and decision tree", *Protection and Control of Modern Power Systems*, **4**(1), 27 (2019). <https://doi.org/10.1186/s41601-019-0139-z>
17. Severoglu, N. and Salor, O. "Statistical models of EAF harmonics developed for harmonic estimation directly from waveform samples using deep learning framework", *IEEE Transactions on Industry Applications*, **57**(6), pp. 1-7 (2021).
<https://doi.org/10.1109/TIA.2021.3114127>
18. Yang, J., Ma, H., Dou, J., et al. "Harmonic characteristics data-driven THD prediction method for LEDs using MEA-GRNN and improved-Adaboost algorithm", *IEEE Access*, **9**, pp. 31297-31308 (2021).
<https://doi.org/10.1109/ACCESS.2021.3059483>
19. Yasin, Z.M., Ashida Salim, N., and Ab Aziz, N.F. "Harmonic distortion prediction model of a grid-connected photovoltaic using grey wolf optimizer-least square support vector machine", 2019 9th *International Conference on Power and Energy Systems, ICPES 2019, Institute of Electrical and Electronics Engineers Inc.*, pp. 1-6 (2019).
<https://doi.org/10.1109/ICPES47639.2019.9105398>
20. Panoiu, M., Panoiu, C., Mezinescu, S., et al. "Machine learning techniques applied to the harmonic analysis of railway power supply", *Mathematics*, **11**(6), 1381 (2023). <https://doi.org/10.3390/math11061381>
21. Nefabas, G. and Zhao, H. "Power system harmonics estimation using generalized least mean mixed norm adaptive algorithm", *ACM International Conference Proceeding Series*, pp. 249-254 (2021).
<https://doi.org/10.1145/3458380.3458423>
22. Yuan, W., Yuan, X., Xu, L., et al. "Harmonic loss analysis of low-voltage distribution network integrated with distributed photovoltaic", *Sustainability (Switzerland)*, **15**(5), 4334 (2023).
<https://doi.org/10.3390/su15054334>
23. Kuyunani, E.M., Hasan, A.N., and Shongwe, Th. "Improving voltage harmonics forecasting at a wind farm using deep learning techniques", *IEEE International Symposium on Industrial Electronics*, pp. 1-6 (2021).
<https://doi.org/10.1109/ISIE45552.2021.9576357>
24. Li, Y., Sun, Y., Wang, Q., et al. "Probabilistic harmonic forecasting of the distribution system considering time-varying uncertainties of the distributed energy resources and electrical loads", *Appl. Energy*, **329**, 120298 (2023).
<https://doi.org/10.1016/j.apenergy.2022.120298>
25. Rodríguez-Pajarón, P., Hernández Bayo, A., and Milanović, J.V. "Forecasting voltage harmonic distortion in residential distribution networks using smart meter data", *International Journal of Electrical Power and Energy Systems*, **136**, 107653 (2022).
<https://doi.org/10.1016/j.ijepes.2021.107653>
26. Altintasi, C. "Sine cosine algorithm approaches for directly estimation of power system harmonics interharmonics parameters", *IEEE Access*, **9**, pp. 73169-73181 (2021).
<https://doi.org/10.1109/ACCESS.2021.3081037>
27. Hatata, A.Y. and Eladawy, M. "Prediction of the true harmonic current contribution of nonlinear loads using NARX neural network", *Alexandria Engineering Journal*, **57**(3), pp. 1509-1518 (2018).
<https://doi.org/10.1016/j.aej.2017.03.050>
28. Kuyumani, E.M., Hasan, A.N., and Shongwe, T. "A hybrid model based on CNN-LSTM to detect and forecast harmonics: A case study of an Eskom substation in South Africa", *Electric Power Components and Systems*, **51**(8), pp. 746-760 (2023).
<https://doi.org/10.1080/15325008.2023.2181883>
29. Ozer, I., Efe, S.B., and Ozbay, H. "A combined deep learning application for short term load forecasting", *Alexandria Engineering Journal*, **60**(4), pp. 3807-3818 (2021). <https://doi.org/10.1016/j.aej.2021.02.050>
30. Özbay, H. and Dalcı, A. "Effects of COVID-19 on electric energy consumption in Turkey and ANN-based short-term forecasting", *Turkish Journal of Electrical Engineering and Computer Sciences*, **29**(1), pp. 78-97 (2021). <https://doi.org/10.3906/elk-2006-29>
31. Bedi, J. and Toshniwal, D. "Deep learning framework to forecast electricity demand", *Appl Energy*, **238**, pp. 1312-1326 (2019).
<https://doi.org/10.1016/j.apenergy.2019.01.113>
32. Kocaman, B. and Tümen, V. "Detection of electricity theft using data processing and LSTM method in distribution systems", *Sadhana-Academy Proceedings in Engineering Sciences*, **45**, 286 (2020).
<https://doi.org/10.1007/s12046-020-01512-0>

33. Ma, J., Cheng, J.C.P., Jiang, F., et al. "A bi-directional missing data imputation scheme based on LSTM and transfer learning for building energy data", *Energy Build*, **216**, 109941 (2020).
<https://doi.org/10.1016/j.enbuild.2020.109941>
34. Cho, K., Van Merriënboer, B., Gulcehre, C., et al. "Learning phrase representations using RNN encoder-decoder for statistical machine translation", 2014 *Conference on Empirical Methods in Natural Language Processing*, pp. 1724-1734 (2014).
<https://doi.org/10.48550/arXiv.1406.1078>
35. Jozefowicz, R., Zaremba, W., and Sutskever, I. "An empirical exploration of Recurrent Network architectures", 32nd *International Conference on Machine Learning, ICML*, **37**, pp. 2342-2350 (2015).
36. Amodei, D., Anubhai, R., Battenberg, E., et al. "Deep speech 2: End-to-end speech recognition in English and Mandarin", *International Conference on Machine Learning*, New York (2016).
<https://doi.org/10.48550/arXiv.1512.02595>
37. Cahuantzi, R., Chen, X., and Güttel, S. "A comparison of LSTM and GRU networks for learning symbolic sequences", In Arai, K. (Eds.) *Intelligent Computing. SAI 2023. Lecture Notes in Networks and Systems*, pp. 771-785, **739** (2021).
https://doi.org/10.1007/978-3-031-37963-5_53
38. Yamak, P.T., Yujian, L., and Gadosey, P.K. "A comparison between ARIMA, LSTM, and GRU for time series forecasting", *ACM International Conference Proceeding Series, Association for Computing Machinery*, pp. 49-55 (2019).
<https://doi.org/10.1145/3377713.3377722>
39. Yiğit, E., Özkaya, U., Öztürk, Ş., et al. "Automatic detection of power quality disturbance using convolutional neural network structure with gated recurrent unit", *Mobile Information Systems*, **2021**, pp. 1-11 (2021). <https://doi.org/10.1155/2021/7917500>
40. Dong, Y., Zhang, F., Li, X., et al. "Nonlinear load harmonic prediction method based on power distribution internet of things", *Sci., Program*, **2021**, pp.1-12 (2021). <https://doi.org/10.1155/2021/9978900>

Biographies

İsmail Bozdağ works as an Electrical and Electronics Engineer in Bandırma Organized Industrial Zone. He received his BSc and MSc degrees in Electrical and Electronics Engineering in 2017 and 2022, respectively. His research interests include electrical power quality and power system analysis.

Serhat Berat Efe is currently an Associate Professor in Electrical Engineering Department at Bandırma Onyedi Eylül University, Türkiye. He received his BSc, MSc, and PhD degrees in 2003, 2007, and 2014 respectively, all in Electrical and Electronics Engineering. His research interests include illumination, electrical power quality and electrical power system analysis.

İlyas Özer is currently an Associate Professor in Computer Engineering Department at Bandırma Onyedi Eylül University, Türkiye. He received his BSc degree in 2010 in Electrical and Electronics Engineering, MSc and PhD degrees in 2013 and 2018, respectively in Computer Engineering. His current research interests include signal processing, evolutionary computation, machine learning, big data, deep neural networks and their industrial applications.